



# Network Development Plan

**2022**

Methodology Report

## Version Control

Issue	Date
1 – consultation draft	31/03/2022

## Contact Details

### Email

[wpdnetworkstrategy@westernpower.co.uk](mailto:wpdnetworkstrategy@westernpower.co.uk)

### Postal

Network Strategy Team  
Western Power Distribution  
Feeder Road  
Bristol  
BS2 0TB

### Disclaimer

Neither WPD, nor any person acting on its behalf, makes any warranty, express or implied, with respect to the use of any information, method or process disclosed in this document or that such use may not infringe the rights of any third party or assumes any liabilities with respect to the use of, or for damage resulting in any way from the use of, any information, apparatus, method or process disclosed in the document.

© Western Power Distribution 2022

No part of this publication may be reproduced, stored in a retrieval system or transmitted, in any form or by any means electronic, mechanical, photocopying, recording or otherwise, without the written permission of the DSO Manager, who can be contacted at the addresses given above.

## Contents

Introduction .....	4
Network Development Plan Structure .....	4
Stakeholder Consultation .....	5
WPD Investment Planning Process .....	6
Forecasting: Distribution Future Energy Scenarios .....	6
Optioneering: Distribution Network Options Assessment .....	7
Interaction with other Western Power Distribution documents.....	8
Network Analysis Approach.....	10
Input Data .....	10
Customer Assets:.....	10
Assessment Periods .....	12
Constraint Identification .....	12
Balance between detailed and simplified analysis.....	16
Network Headroom Report Methodology.....	17
Constraint Identification .....	17
Modelling limitations.....	18
Network Development Report Methodology .....	20
Constraint Identification .....	20
Constraint Alleviation .....	22
Benefits over firm capacity style analysis .....	23
Modelling limitations.....	23
Future Developments .....	24
Glossary .....	25

## Introduction


The [Clean Energy Package \(CEP\) \(EU Directive 2019/944\)](#) comprises European legislation for a unified energy strategy for delivering the Paris agreement. As part of the Clean Energy Package introduction into UK law, Standard Licence Condition SLC 25B has been introduced for electricity Distribution Network Operators (DNOs) to publish a Network Development Plan (NDP).

The NDP has three distinct purposes:

- To assess the future suitability of the distribution network for continuing to deliver for customers under credible future energy scenarios across the next 5 to 10 years;
- To identify sites that require intervention due to network constraints, assessing the options available to remedy the constraint to ensure the network complies with relevant design standards and technical limits of assets. Solutions could be provided through flexibility services, conventional reinforcement or operational mitigation; and
- To provide Ofgem and wider stakeholders with transparent plans to develop the distribution network and continue to enable the transition to Net Zero.

## Network Development Plan Structure

Through the Open Networks project; Western Power Distribution (WPD) and other electricity networks have developed a form of statement for the NDP. The objective is to define the common high-level end-to-end process for delivering the NDP licence requirements in the context of planning network investments and other reporting. The form of statement for the NDP is available [here](#). The form of statement describes three constituent parts for the NDP, as outlined in Figure 1 below.

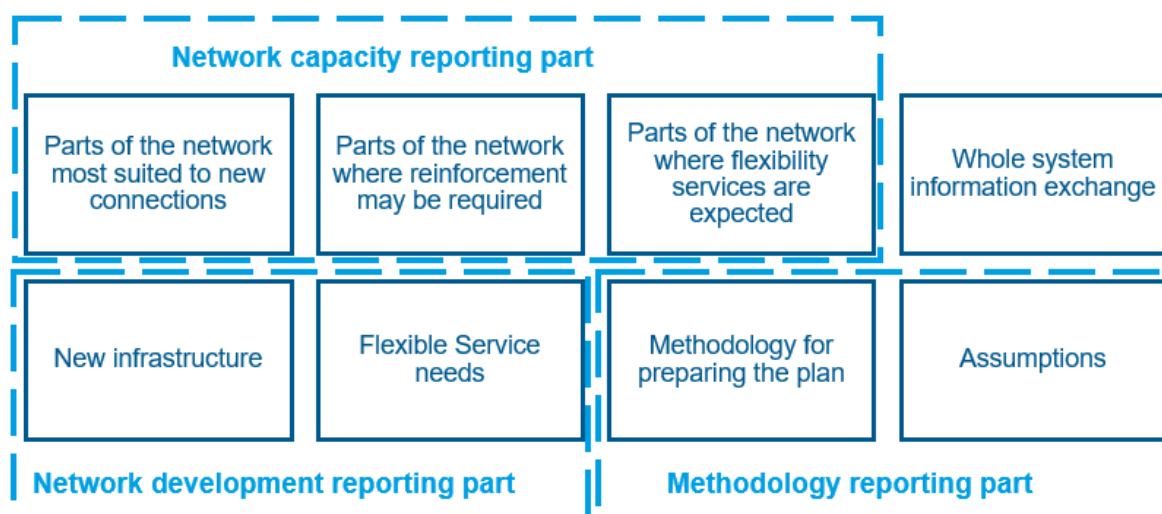

**Figure 1: Outline of three parts of the Network Development Plan (taken from the [NDP form of statement](#))**

The NDP comprises of this methodology document, the Network Headroom Report (NHR) and the Network Development Report (NDR). This report outlines the methodology used for each component of the NDP and how the process aligns to the WPD investment planning process.



## Stakeholder Consultation

Standard Licence Condition SLC 25B.8 states as part of the NDP, the licensee must:

- a) consult interested parties on the proposed NDP for a period of at least 28 days before publishing as required by 25B.1; and
- b) publish the non-confidential consultation responses

The interested parties identified for the NDP are outlined in Table 1.

**Table 1 – NDP stakeholders**

### Interconnected electrical network operators

- Other DNOs, IDNOs, TO, ESO

### Community Energy

### Local Authorities (LA) / Government organisations

### Flexibility Service providers

### Other network operators

- Transport
- Gas network
- Water network

### Developers

- Property/ Building, Generation, Industrial customers, Generation customers

### Universities


Initial drafts of the Network Development Plan reports is available on the WPD website in conjunction with consultation questions, to gather feedback on the methodology used and format of information presented. In addition, WPD are hosting a [consultation webinar](#) on 31st March 2022 to seek further feedback from stakeholders.

The consultation responses will be published in this report for the final submission of the NDP in May 2022.

## WPD Investment Planning Process

Throughout the RII0-ED1 price control period, WPD has developed strategic planning capability and processes to investigate how growth projections will affect the design and operation of the distribution network. Providing transparency in each step of the investment planning process provides stakeholders with confidence as to how DNOs plan to develop distribution networks to enable the UK transition to Net Zero.

The NDP forms an important part of the WPD investment planning process, as outlined in Figure 2. The network impact assessment process aims to identify where and when network constraints could materialise as a result of forecast projections; and identify and model suitable mitigation options to any constraint. To demonstrate that any decision on load related investment is economic, coordinated and efficient, the network impact assessment must correctly detect network constraints.

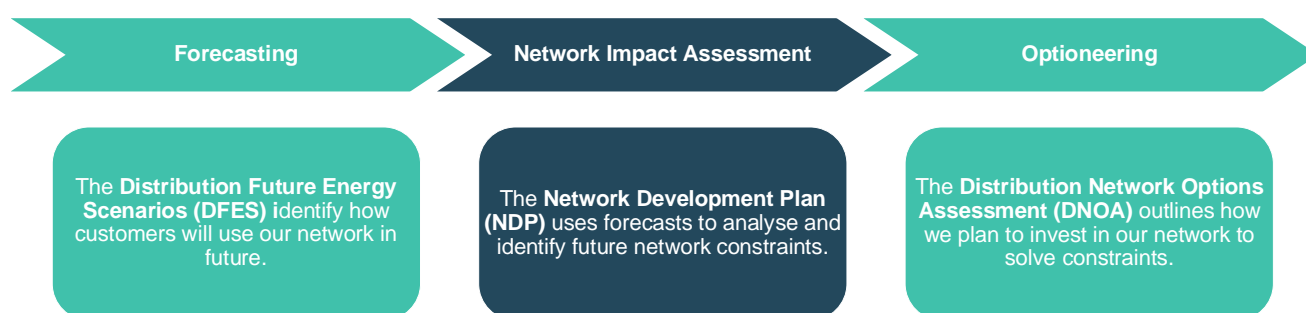

**Figure 2: Diagram of end-to-end WPD investment planning process.**

A summary of the forecasting and optioneering stages are outlined below.

### Forecasting: Distribution Future Energy Scenarios

The first step in WPD's load related planning methodology is establishing a forecast of future network loads across each of our four licence areas. Since 2015, WPD has been undertaking scenario planning work through Distribution Future Energy Scenarios (DFES) reports, updating these on a two-yearly cycle to provide a forward looking 10 year window of potential low carbon technology uptakes. From 2020, a full suite of DFES documents have been produced annually which consider a horizon out to 2050. The DFES projections are aligned to a common scenario framework, to allow for comparison between DFES publications from different DNOs and the Electricity System Operator Future Energy Scenarios (FES) publication.

In addition to the four scenarios used as part of the DFES, a WPD Best View scenario is also created. This outlines the expected growth pathway over a 0-10 year period, and it built on detailed stakeholder engagement.

A suite of documents related to the DFES are available on the [WPD website](#) and the data can be viewed on the [DFES map](#) on the WPD website, as shown in Figure 3.

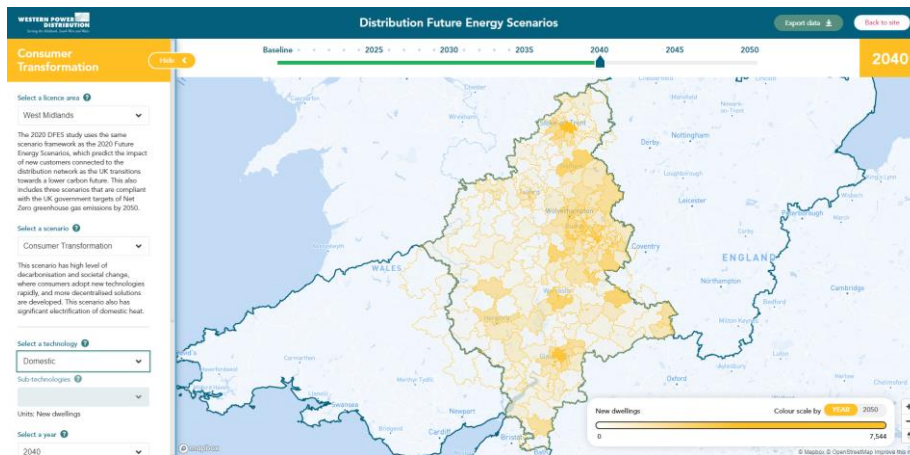


Figure 3: Screenshot from WPD DFES map interface, to allow stakeholders to explore forecast projections.

## Optioneering: Distribution Network Options Assessment

As part of WPD's extra high voltage (EHV) optioneering process, the Distribution Network Options Assessment (DNOA) is a document published twice a year providing transparency in the investment decision making process. The DNOA uses the [Common Evaluation Methodology \(CEM\)](#) developed under the Open Networks project to compare options and identify low regret pathways. Conventional reinforcement is always considered as a base case, with flexibility considered alongside. In some cases, alternative conventional solutions are also considered or additionally other innovation solutions that might be available, for example voltage management or compensation. The constraints identified in the NDP will be assessed as part of the DNOA process.

The DNOA report is refreshed twice annually and updated on the [WPD website](#).

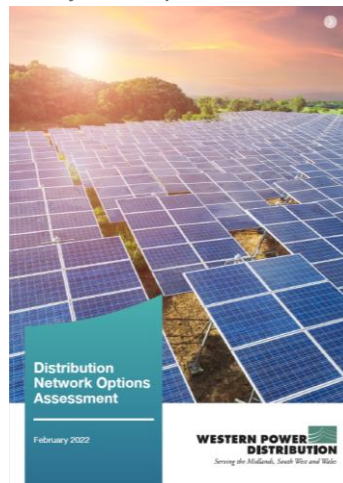



Figure 4: Distribution Network Options Assessment, published in February 2022.

## Interaction with other Western Power Distribution documents

WPD regularly publish information that relates to available capacity and headroom on the distribution network. The interaction between these publications and the NDP is outlined below.

### Shaping Subtransmission Reports

In previous years, WPD published a series of [Shaping Subtransmission](#) reports. These overlaid the DFES projections onto a network model of the 132 kV and 66 kV networks and identified potential network constraints over the medium term outlook. As part of these studies, WPD developed analysis tools and techniques to enable automated analysis of distribution networks. The NDP has formalised this network impact assessment for all DNOs to undertake on a periodic basis. The NDP will supersede the Shaping Subtransmission series of reports from 2022, using an improved analysis methodology.

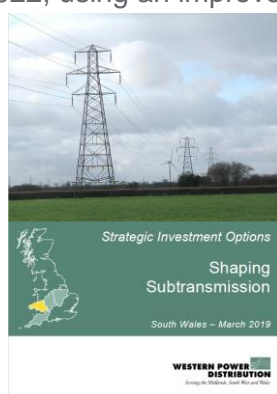

**Figure 5: WPD Shaping Subtransmission South Wales document, published in 2019**

### Long Term Development Statement

The [Long Term Development Statement](#) (LTDS) is a publication compiled in accordance with Electricity Distribution Licence Condition 25, to assist existing and future users of WPD's network in identifying and assessing opportunities available to them for making new or additional use of our Distribution System.

As part of the statement, Table 3 presents forecasts of peak demand on our system in average cold spell conditions. This captures the annual peak demand for each node in the EHV power system model for each licence area, to allow users to apply load assumptions in network assessment. Table 3 also includes a forecast of peak demand for future years, which is based on the WPD Best View scenario. Due to the timing of the publication of the LTDS in November and the DFES in December, the forecast load information is based on the previous year's DFES forecasts and WPD Best View. As a result, the November 2021 publication of the LTDS growth rates is not expected to align with those used for the NDP.

A working group has been established across DNOs to reform the LTDS, which aims to update the LTDS by addressing the interoperability of network data to improve the sharing of planning data and so provide stakeholders with greater understanding of opportunities on the network.



## Network Capacity Map

The [Network Capacity Map](#) provides an indication of the ability of the distribution network to connect large-scale developments to major substations. It can be viewed as a visual representation of some of the data contained in the Long Term Development, with additional information provided for the generation headroom of WPD substations. Information of the National Grid Transmission Statement of Works (SoW) responses are also included, which can affect connection availability.

The Network Capacity Map is regularly updated with snapshot of connection information incorporating recently connected generation, accepted but not yet connected generation and quoted generation connections. These figures regularly change as quotations are issued and expire. As a result, the Network Capacity Map reflects a 'committed' network position, which does not directly correspond to a single scenario or year used as part of the DFES process. Customers with accepted connection offers do not always progress through to connection, which DFES publications take a view on connection likelihood. In addition, DFES forecasts include the growth of small-scale low carbon technologies, which would not typically be captured by a large-scale connection offer.

## RIO-ED2 Business Plan

As part of the submission of a Business Plan for the RIO price control period, WPD undertook strategic analysis of the distribution networks to identify areas of investment for the period from 2023-2028. The constraints identified in the NDP will be aligned to those identified in the RIO-ED2 business planning process. However; due to updates with the starting load assumptions, forecast projections and network models there is expected to be some variation in constraints identified.

## Network Analysis Approach

The NDP aims to identify areas of the distribution network where investment may be required to alleviate a constraint. This section outlines the approach taken to identify network constraints and the input data and tools used.

### Input Data

In order to undertake detailed electrical analysis of any electricity distribution network the four components detailed in the matrix in Table 2 are required. It is important to ensure all four areas of this matrix are included within any analysis to maximise the value and accuracy of the output. Each of these sections are discussed in detail below.

**Table 2 – Summary table of the aspects required for detailed electrical analysis of the distribution network.**

	Network	Customers
Assets	Network topology and connectivity information, including impedance and 'nuts and bolts' data about the assets connected to the WPD network. Normally this is captured in a network model in power system analysis software.	Customers connected to the distribution network, including the type of demand or generation connected. This also includes information on the machines or assets that customers have connected to the network (such as Electric Vehicles or Heat Pumps).
Behaviour	Actions taken by the DNO to actively manage the network. This can be in the form of updated running arrangements once an arranged outage is taken, or load management schemes in place to manage network flows. This information is vital if contingency analysis is required.	Expected behaviour of customers connected to the distribution network, with reference to the focus and purpose of the network analysis to be undertaken.

### Customer Assets: DFES Volume Projections

DFES provide granular scenario projections for the growth (or reduction) of generation, demand and storage technologies which are expected to connect to the Great Britain (GB) electricity distribution networks. The WPD DFES also includes projections for new housing growth and increase in commercial and industrial developments. The projections are also informed by stakeholder engagement to understand the needs and plans of local authorities and other stakeholders.

The development of DFES has enabled WPD to take a more proactive approach to network planning. Stakeholders were consulted via a series of consultation events, as well as direct engagement with local authority planners and climate emergency officers. WPD publishes the DFES volume data as part of a [suite of documents](#), projections are also displayed as part of an interactive map on the [WPD website](#).

## Customer Behaviour: DFES Behaviour Assumptions

The next step in the DFES process is to account for customer behaviour to the projected volumes. This is used to take into consideration the expected demand and generation profiles of new and existing customers connected to the distribution network. This includes assumptions for how customers connected to the distribution network will change over time due to an increase in energy efficiency and pricing-led Demand Side Response (DSR). When the customer behaviour assumptions in this document are applied to the DFES projections a load set of MW/MVAr values can be generated. The NDP uses the latest published LTDS Table 3 data for the starting load assumptions.

Further information on the customer behaviour assumptions is available as part of the [DFES: Customer Behaviour Assumptions Report](#).



**Figure 6: DFES Customer Behaviour Assumptions report for the 2021 edition of the DFES projections.**

## Network Assets: Extra High Voltage Power System Models

Network Assets are modelled through the EHV network models maintained by WPD. The same information is published annually as part of the LTDS, to allow third parties to model the distribution network, but models are constantly updated as assets are replaced and new connections made to the distribution network. The network model must also include the appropriate ratings of network components, accounting for seasonal factors and any cyclic capabilities.

A snapshot of WPD's EHV models was taken on 21<sup>st</sup> January 2022 and these models were used to model the forecast demand sets from DFES. For each year into the future, the models were amended to ensure that future connections were incorporated into the model in the correct year and thus the demand be accurately distributed across the assets. As part of the transition to a common power system analysis software package across WPD, the network models for the East and West Midlands used in this NDP are derived from the model published in the November 2021 LTDS.

## Network Behaviour: Automation and Manual Switching Schemes

In order to accurately identify the point where an investment decision is required, the effects of network automation and manual switching schemes should be included in analysis. If these actions are not modelled, the results may not be representative of how the network would react to specific outages. This could include the behaviour of network automation and manual switching schemes including:

- auto-close schemes;
- intertripping;
- directional overcurrent schemes;
- overload protection;
- sequential control (SQC); and
- load transfers.

## Assessment Periods

Traditionally, distribution networks are assessed using ‘edge-case’ modelling, where only the network condition that is deemed most onerous is analysed. As the installed capacity and behaviour of demand, generation and storage is rapidly changing, it has become difficult to predict what network condition will be most onerous.

To cover a range of likely onerous cases, WPD consider a range of different potential representative days, which are used to assess network capability, as outlined in Table 3. The definition of seasons is taken from [Engineering Recommendation P27/2](#) (Current rating guide for high voltage overhead lines operating in the GB distribution system):

- **Winter:** January, February and December
- **Intermediate Cool:** March, April and November
- **Intermediate Warm:** May, September and October
- **Summer:** June, July and August

**Table 3 - Representative Day descriptions used for analysis within the Network Development Plan**

	Demand Headroom Assessment	Generation Headroom Assessment
Representative Day	<ul style="list-style-type: none"> <li>• Winter Peak Demand</li> <li>• Summer Peak Demand</li> <li>• Intermediate Warm Peak Demand</li> </ul>	<ul style="list-style-type: none"> <li>• Summer Peak Generation</li> </ul>
Justification	<p>The peak demand is assessed with minimum coincident generation. Coverage of all seasons allows for an assessment of the network’s capability to meet not only annual peak demand conditions but also the demand conditions during periods of planned maintenance on the network.</p>	<p>The peak generation representative day is assessed with minimum coincident demand. This aims to provide an assessment of the network’s capability to handle generation output. The season where generation constraints most normally occurs is during summer, with relatively low demand and high output of renewable generation.</p>

The expected peak network loading under different seasons can be compared against the seasonal rating of assets. The demand profile for many areas of the network show that although the peak demand may often appear in the cooler months, the reduction of the network’s asset ratings in the subsequent warmer seasons can be greater than the corresponding reduction in demand.

## Constraint Identification

The distribution network is designed to comply with a number of electricity engineering standards and policies, as listed in the sections below. If steady state load flow analysis identifies a deficiency in the network for any one of the assessment criteria below, an investment decision is required.

It is worth noting that strategic planning is not the only method of identifying load related investment on the distribution network. Constraints identified as part of new connections planning and condition based asset replacement programmes can also affect investment decisions. These are appraised as part of the DNOA.

## Contingency analysis

Contingency analysis is the analysis of the network under abnormal conditions to confirm that the network complies with [Engineering Recommendation P2/7](#), which outlines the minimum standards for the demand security of supply that must be provided to customers. Any security assessment should accurately cover the assessment process in Section 4 of [Engineering Report 130](#), which provides guidance on the application of Engineering Recommendation P2/7. The demand and generation capacity of a network is not normally limited by its characteristics under normal running conditions, but by its characteristics under abnormal running conditions. There are two broad classes of network outage:

- **Fault outages:** when a component of the network fails, it is detected by protection relays, which open the circuit breakers enclosing the failed component. This de-energises the network between those circuit breakers, so clearing the fault. By their nature, fault outages cannot be predicted so may be expected to happen at any time;
- **Arranged outages:** each component of the network needs to be accessed for periodic or condition-driven inspection, maintenance and replacement. Similarly, access may be required for reinforcement or to make new connections. The minimum zone to access any particular component is usually defined by the isolators enclosing the component. The scheduling of arranged outages is flexible to some extent, so can take advantage of seasonal variation in network loading.

Since any component of the network could fail, it is necessary to assess the impact of each credible fault outage on the network. Since each component of the network will need to be accessed eventually, it is necessary to assess the impact of each credible arranged outage on the network. These are both types of First Circuit Outage (FCO). When combining these two requirements, it is also possible that a network component could fail during access to another network component. It is therefore also necessary to assess the impact of each credible fault outage during each credible arranged outage. Each combination is a Second Circuit Outage (SCO).

To undertake contingency analysis, a network model that can accurately replicate outage conditions is required. This includes circuit breakers and isolators, to determine protective and isolatable zones respectively. The following outage types and combinations of outage types should be studied on the distribution networks (and associated transmission networks if necessary):

- the intact (normal running) network;
- each circuit fault;
- each busbar fault;
- each arranged circuit outage;
- each arranged circuit outage followed by each circuit fault;
- each arranged busbar outage;
- each arranged busbar outage followed by each circuit fault.

Power systems analysis is necessary to accurately quantify the intrinsic network capacity and transfer capacity available of a network, particularly for networks operating with complex configurations. Some of the EHV networks in WPD licence areas have complex running arrangements which necessitate multiple contingencies to be studied in different areas to capture the worst case outage combination.



## Network Integrity

The definition of network integrity is defined as the ability of a network to operate within thermal, voltage and other technical limits, excluding frequency-related limits, under both intact network and outage conditions. The technical limits covered by the NDP analysis are discussed below, more information on the limits with which WPD operates its network can be found in the following documents published by WPD:

- [Policy Document: SD4/9](#) (Relating to 11kV and 6.6kV Network Design).
- [Policy Document: SD3/9](#) (Relating to 66kV and 33kV Network Design).
- [Policy Document: SD2/8](#) (Relating to 132kV Network Design).

It is worth noting that for network integrity analysis, WPD cover secured outage conditions in excess of those identified in Engineering Recommendation P2/7, such as busbar fault outages and arranged outages followed by busbar fault outages.

## Thermal assessment

In addition to security assessments, comprehensive network analysis can highlight assets that could operate outside of their technical limitations. Depending on the network running arrangements, a network could comply with the demand security of supply standard requirements, but still result in overloaded assets under different outage combinations. At this point, an investment decision must be made by the DNO to do one of the following:

- Reinforce overloaded assets to alleviate the network constraint. Note this could also encompass wider strategic works rather than uprating overloaded assets;
- Load management schemes to manage network loading and voltages by either controlling demand and/or generation connected to the network, operating switchgear to change the topology of the network and/or controlling the settings of tap-change controllers, reactive compensation equipment and flexible power links.;
- Operational mitigation to reduce the risk of overloads occurring, which could include limiting the window where arranged outages can be taken.
- Procure flexibility services from customers (where technically appropriate to do so) to reduce network asset loading.

Studying multiple seasons is important for the thermal loading assessment to highlight the season where an overload is most likely to occur, as operational mitigating measures or flexibility services could be utilised to defer conventional reinforcement.

## Voltage assessment

The [Electricity Supply, Quality and Continuity Regulations \(2002\)](#) define the limits on voltage which distribution network operators can supply to customers. These are dependent on the voltage level and provide a bandwidth for which the voltage at customer terminals must stay within. These limits influence the design of voltage control on all levels of distribution networks and must be accounted for when identifying strategic developments.

Network analysis should identify any voltage exceedances outside of statutory limits for intact network conditions and all secured outage conditions. Solutions to mitigate any voltage exceedances could include reactive power compensation or network reconfiguration, in addition to reactive power services provided by customers.

### **System Integrity**

System integrity is the ability of the GB system to operate within acceptable frequency-related technical limits under both intact network and outage conditions. System integrity is primarily managed by National Grid, but it can be affected by the operation of WPD's network and customers. This could include a change of load across all WPD licence areas greater than 300 MW, which could result in system integrity issues on the electricity system.

No power system stability studies have been carried out for the NDP; however, constraints highlighted that impact the transmission/distribution boundary are an indication that further whole system studies are required with the GB System Operator and Transmission Network Operators. If necessary, these will be progressed through Regional Development Programmes (RDPs).

### **Fault Level**

Calculation of fault levels should be carried out in accordance with [Engineering Recommendation G74/2](#), which was introduced in July 2021 with a year period for networks to implement. Switchgear stressing assessment is required as it can form a large part of strategic investment planning decisions, as the impacts of fault level studies can limit running arrangements on distribution and transmission networks.

### **Complexity of Circuits**

Engineering Recommendation P18 relates to the complexity of 132 kV circuits, this assessment is carried out for intact network conditions only. WPD also applies the complexity of 132 kV circuits to 33 kV and 66 kV networks.

### **Other relevant network design standards**

In addition to network security, integrity and voltage studies on a network, there are additional standards that DNOs must follow when designing networks. These are outlined below, but are currently outside the scope of the NDP, which are considered for specific customer connections so are covered by the existing connection planning process:

- Voltage unbalance as defined in [Engineering Recommendation ER P29/1](#).
- Voltage fluctuations as defined in [Engineering Recommendation ER P28/2](#).
- Harmonic limits as defined in [Engineering Recommendation G5/5](#).

## Balance between detailed and simplified analysis

Comprehensive electrical analysis is required to accurately identify network constraints and suggest solutions. Developments in the automation of power system analysis tools means that this analysis is becoming more feasible, quick and inexpensive. Comprehensive analysis techniques require manual interrogation of results by power system engineers, and modelling of network interventions to enable model convergence in longer-term studies.

However, accounting for the number of outage combinations and representative day inputs that are required for the analysis outlined above results in approximately 3.5 billion individual load flow studies for each scenario and year combination for all WPD EHV networks. With the projected growth in demand and generation connected to distribution networks in years approaching 2050, a large amount of network interventions are required to ensure the steady state load flow analysis can calculate valid results (i.e. the load flow is able to converge).

As a result, DNOs must choose between different approaches to satisfy the licence conditions in the NDP. For the different component reports in the NDP, WPD run two processes in parallel to produce the most accurate network analysis results. This is summarised in Table 4, and explained in the following sections of this report.

**Table 4: Summary of network analysis methodologies**

Component	Network Headroom Report	Network Development Report
<b>Input</b>	DFES 2021 for starting load assumptions and forecast projections. EHV Network Models for asset data, as reported in LTDS.	DFES 2021 for starting load assumptions and forecast projections. EHV Network Models for asset data, automation and manual switching schemes modelled.
<b>Analysis Type</b>	Comparison of demand/generation and firm capacity as defined in Ofgem RIIO-ED1 Regulatory Information and Guidelines.	Load flow contingency analysis of all outage combinations and reporting of thermal, voltage and demand security constraints.
<b>Network coverage</b>	Whole network	Targeted areas where network development required.
<b>Benefits</b>	Allows for coverage of all substations within the WPD extra high voltage networks for a period out to 2050, and is quick and simple to produce.	Accurate constraint identification that aligns to DNO investment planning and operational processes, remedial solutions can be modelled to check suitability.
<b>Disadvantages</b>	Not comprehensive enough to accurately identify the point where an investment decision is required.	Computationally expensive, requires automated tools to undertake network analysis.
<b>Justification</b>	Suitable as an indication of likely network constraints in future years out to 2050	Detailed analysis required to justify investment decisions made.

## Network Headroom Report Methodology

This section outlines the analysis methodology used to obtain the network headroom figures contained in the Network Headroom Report. This builds on the Network Headroom Report published in 2021 for stakeholder consultation on the format. On the [WPD website](#), a workbook for each licence area contains the network headroom for both additional demand and generation connections across the four DFES scenarios as well as the WPD Best View. These are included for all years out to 2050. The methodology for both demand and generation headroom is discussed separately below.

### Constraint Identification

#### Demand Headroom Calculation

To assess the current and future available capacity and to identify constraints that require intervention during the DFES time horizon, scenario growth data was compared against the firm capacities for each Primary substation and Bulk Supply Point (BSP), whereby:

- A Primary substation refers to a substation where the low voltage side of the voltage transformation is either 11 kV or 6.6 kV. This is consistent with the definition of the Electricity Supply Areas used in the DFES studies. Note that this encompasses sites with 132/11 kV transformation, which are also sometimes referred to as Bulk Supply Points;
- A Bulk Supply Point refers to a substation where the high voltage side of the voltage transformation is 132 kV and the low voltage side of the voltage transformation is either 33 kV or 66 kV.

The firm capacities are consistent with those published in Table 3 of the LTDS and on the Network Capacity Map application. Growth rates were calculated at a Primary substation level, so to produce suitable projections at a BSP level the average growth rates of the primaries downstream from each BSP were applied to the max demands in 2020/21 from the LTDS. This approach helps account for diversity and should produce more accurate projections than simply summing the Primary demand sets. The headroom available at the upstream BSP can be used to infer if there is a potential constraint on the upstream network that could affect the capacity for connections at lower voltage levels.

#### Generation Headroom Calculation

For the Network Headroom Report, generation headroom is also included as it is acknowledged that the NDP must meet the needs of different stakeholders interested in both generation and demand connection capacity. The calculation for the generation headroom consists of two parts, each discussed below.

##### Thermal headroom

For the Summer Peak Generation representative day, the net loading at each Primary substation and BSP is calculated by subtracting the maximum credible coincident generation output from the expected demand profile each half hour. The half hour where the net loading was minimum is identified as the edge-case required for generation headroom analysis. It is worth noting that this does not necessarily correlate to the half hour of maximum generation output, nor to the half hour of minimum demand. It is particularly important to understand the generation technologies connected within an area to appropriately forecast the worst case network conditions for generation headroom assessment.

The net loading for each Primary substation is compared against the reverse power flow ratings consistent with those used in the WPD Network Capacity Map to calculate the generation headroom. The reverse power flow headrooms are calculated from the LTDS where available, and assumed to be 50% of the firm capacity rating where unavailable in the LTDS. A negative headroom does not necessarily result in a network constraint, as through alternative connection offers and load management schemes such as Active Network Management (ANM), some customers can be constrained for certain outage conditions to ensure no overloading of assets occurs.

### **Fault level headroom**

Consideration of fault level is included because it is a major constraint on generation connections. For the Network Headroom Report, an initial fault level assessment is undertaken. The existing maximum prospective fault levels under normal system running conditions and the make and break switchgear ratings at bussing points are taken from the LTDS Table 4, which is consistent with the Network Capacity Map.

The additional generation expected to connect at each Primary substation for each year, scenario and generator type is calculated using an expected fault infeed contribution consistent with the figures published in the [Western Power Distribution Policy Document: SD7F/2](#). This is added onto the existing maximum fault level and compared to the switchgear make and break ratings to calculate a fault level headroom in kA.

In order to provide a single figure for the generation headroom, the fault level headroom in kA is converted to an equivalent assumed power figure of generation to connect to the network. This uses an assumed weighted average for the make and break fault infeed contribution of all projected generation to connect across the DFES horizon. The minimum of the thermal and fault level MW headroom is then chosen as the generation headroom for any given year, scenario and Primary substation.

## **Modelling limitations**

### **General**

1. The impacts of planned reinforcements, contracted flexibility and load management schemes are not included in the Network Headroom Report. For certain outage conditions load management schemes may operate to constrain customers to ensure no overloading of assets occurs. Comprehensive power systems analysis is required to model the impacts of load management schemes.
2. In the Network Headroom Report, when a potential network constraint is identified no reinforcement is modelled to alleviate the network constraint. Comprehensive power systems analysis requires network interventions to be modelled in order to enable model convergence in future years – these are modelled for the areas considered in the Network Development Reports.
3. To enable accurate analysis on the distribution network, a representative Transmission model is necessary. This Transmission representation is an equivalent of the full Transmission network and, when incorporated into the WPD power system model, approximates the network behaviour. This data is provided by National Grid as part of the Week 42 data exchange. The size of the equivalent model varies for each licence area, depending on the level of GSP parallel running and interconnection. Currently transmission models are not provided for future years, scenarios and seasons, which could increase the accuracy of future headroom modelling.



### Thermal headroom analysis

4. For both demand and generation network headroom assessments, a firm capacity style analysis may not fully capture the complex nature in which distribution networks are run. Where areas of the distribution network run interconnected, each distinct area cannot be studied in isolation the network loading is susceptible to changes in other parts of the parallel group. Comprehensive power systems analysis is required to fully capture the available headroom for the distribution network.
5. A firm capacity style analysis may define the headroom available to connect demand or generation at a particular voltage level, however this may not capture the available headroom at upstream voltage of the distribution network, which may be the limiting factor to connect new demand and generation. Again, comprehensive power systems analysis is required to fully account for the materiality headroom for different parts of the distribution network.

### Fault level analysis

6. The fault level analysis only considers the additional fault infeed from generation connected at each Primary substation in isolation. It does not account for wider network changes that would affect upstream fault infeed due to the connection of additional distributed generation (DG), removal of generation (particularly synchronous plant) and changes in network topology. To assess changing fault level accurately detailed power system analysis is required, with a future National Grid equivalent model representing the appropriate year, scenario and loading condition.
7. Only three phase faults were considered in the initial fault level analysis for generation headroom assessment.
8. Fault level assessment assumes that new demand and generation would connect directly to the 11 kV or 6.6 kV bar of the Primary substation. As a result, this is a worst-case assumption as no additional impedance assumptions have been made for the connection of new demand and generation.

## Network Development Report Methodology

This section outlines the analysis methodology used in the Network Development Reports, which contains the results of comprehensive power systems analysis that has been carried out on areas of the network where developments are required. This analysis was performed using the four DFES scenarios as well as the WPD Best View and each section of network is assessed across the next 10 years. The methodology of this analysis is discussed below.

Areas where network developments are likely to be required in the 0-10 year window were identified from existing analysis undertaken for the RIIO-ED2 business plan, also from study of the baseline year across different part of the WPD network. Each area of network where an investment decision is required in the 0-10 year window is reported as a series of short technical reports. These will provide the justification of the required investment to stakeholders through robust evidence and technical detail.

Throughout RIIO-ED1 WPD has developed a tool for automated analysis of EHV distribution networks, aligning to the comprehensive electrical analysis as outlined in the *Network Analysis Approach* section of this report. The Switch-Level Analyser tool is a bespoke power system analysis program written in Python 2.7. It uses PSS/E version 34 as its core analysis engine to perform the actual load-flow calculations, and uses some of PSS/E's built-in contingency analysis tools for efficiency.

All input data for studies are stored on a centralised server-side database. The following inputs are combined for each half hour, representative day, year and scenario studied:

- Network model, including network changes made relative to the year studied;
- Load set mapped to the boundary nodes of the network model (aligned to the definition of an Electricity Supply Area used in the DFES studies). This also includes half-hourly profiles for each type of demand, generation and storage and representative day;
- Appropriate ratings of network components; and
- Existing network automation and manual switching schemes.

These results are processed within the program and exported to a results database, which are summarised in tabular and graphical formats for further evaluation by skilled power systems engineers. Whilst this approach can be seen as computationally expensive, a distributed computing approach is used to improve runtime efficiency.

### Constraint Identification

#### Outage Modelling

To assess the current and future constraints that require intervention during the 0-10 year horizon, all outage combinations are studied using the Switch-Level Analyser tool. Each study is broken into a specific year, scenario, half hour and representative day for a focused area of network. Where areas of the distribution network run interconnected, the network is studied as a whole to account for changes in other parts of the parallel group and fully capture the constraints for the distribution network.

For each half hour, day, year and scenario studied, the program returns the following for all outage combinations modelled:

- MVA flow on all branches of interest;
- Voltage exceedances for all nodes of interest;
- Lost load (i.e. demand disconnected) for all groups;

- Group load (i.e. the demand and generation of each GSP, BSP and primary substation group) for all networks; and
- Any studies where the program was unable to calculate valid results (non-convergences).

### Modelling Network Automation and Manual Switching Schemes

The demand and generation capacity of a network is not normally limited by its characteristics under normal running conditions, but by its characteristics under abnormal running conditions. Abnormal running arrangements occur due to faults, maintenance, network construction and other reasons. The Switch-Level Analyser tool uses the PSS/E Advanced Contingency and Remedial Action Scheme (RAS) add-on module. This module takes user-defined conditions and performs an action dependent on the outcome of the condition. WPD has used this module to model the behaviour of network automation and manual switching schemes as outlined in the *Network Behaviour: Automation and Manual Switching Schemes* section of this report. The modelling of schemes is agreed and confirmed with WPD Primary System Design and Outage Planning Teams. Details on specific Remedial Action Schemes modelled are included in each of the individual Network Development Reports as part of the NDP publication.

#### Network reconfiguration

Under outage conditions, the topology of the EHV distribution network can be altered, either by WPD Control Engineers or by network automation. This can be to ensure network compliance is maintained, to reduce the risk of overloading assets for a credible next fault or to limit the Customer Interruptions (CIs) and Customer Minutes Lost (CMLs) for a credible next fault.

As each outage combination is simulated on the network model, the Switch-Level Analyser checks the status of isolators and circuit breakers across the monitored contingency area. If the user-defined condition statement returns true, a subsequent switching action is taken as would be by the WPD Control Engineer or network automation scheme.

#### Load Management Schemes

A Load Management Scheme is defined as plant, equipment and software systems that together manage network loading and voltages by either controlling demand and/or generation connected to the network, operating switchgear to change the topology of the network and/or controlling the settings of tap-change controllers, reactive compensation equipment and flexible power links.

Load Management Schemes are modelled to account for the following:

- Protection style intertrip schemes to automatically disconnect parts of network for a certain network condition;
- Auto-changeover and auto-close schemes, such as to switch in a transformer run on hot standby under fault outage conditions;
- Overload protection schemes, to cover

Active Network Management is also included as a Load Management Scheme. The existing analysis tools do not replicate the ANM logic, which requires iterative load flows to control generation or demand according to the Last In First Out (LIFO) stack of connected customers. The behaviour for customers with existing ANM contracts is modelled to validate the behaviour of existing systems.

### Flexibility Services

Flexibility services can be used to reduce network loading for a given condition through network users in their own consumption by increasing, reducing or shifting their net import or export during peak loading periods. The analysis takes into account existed contracted flexibility which can be relied upon for security and network integrity assessments, and this is included in the models to validate that the procured services can alleviate the network constraint.

In future years, the flexibility services required to alleviate a network constraint identified can be quantified by reducing the loading on any constrained circuit. The location of any flexibility services procured has a sensitivity to a given constraint, which must be factored into the decision for procurement of services.

### Constraint Alleviation

Upon the identification of a constraint, solutions can be modelled and assessed for suitability to alleviate the network constraints. Each of the following remedial solutions are considered and modelled for their impact on the network studied and adjacent/interconnected networks.

- **Conventional reinforcement** - for example replacing overloaded assets with increased ratings;
- **Strategic reinforcement** – where multiple constraints are identified in the same area of network, a more cost effective solution could be to establish new substations to increase the capacity of the group. This can help with network security assessments by ensuring the group demand remains within the existing P2 Class of Supply;
- **Operational mitigation** – actions taken by WPD to alter how assets are maintained and operated. Examples could include limiting when arranged outages can be taken on the network to reduce the risk of any subsequent credible next fault overloading network assets;
- **Load Management Schemes** – installation of network automation to manage network loading for given conditions through control of demand and/or generation through operational measures, as part of existing customer connection agreements. This could include modelling of additional load on the network connected to an Active Network Management scheme;
- **Flexibility Services** – procurement of services from customers connected within the area of network studied to reduce loading on network assets under different conditions. Services will be procured through commercial contract arrangements. This can be quantified using the detailed network analysis, but commercial analysis is required to ascertain if services are available to procure that is outside the scope of the NDP.

A key aspect of the comprehensive network analysis is the ability to model the solution options to ensure that any solution is fit for purpose in future years in the 0-10 year horizon as covered by the NDP. For network build solutions, these are also checked against expected growths to reduce asset stranding risks out to 2050.

Once the solution options are confirmed for a constraint, costs for each option are generated along with likely timescales. The options are then appraised as part of the DNOA, which uses a cost benefit analysis methodology to justify the near-term investment decision made.

## Benefits over firm capacity style analysis

The comprehensive approach to network analysis used for the Network Development Reports has the following advantages over the analysis used for the Network Headroom Report.

- The impacts of planned reinforcements, contracted flexibility and load management schemes are included. Under outage conditions, load management schemes may operate to constrain customers to ensure no overloading of assets occurs. The impacts of these actions.
- Using power systems analysis tools to undertake can accurately quantify problems on interconnected networks. An example of this is the available transfer capacity to an adjacent network, which may be required for network compliance. This transfer capacity is dependent not only on the interconnecting circuit capacity, but also on the available capacity of the adjacent demand group to accept load transfers. This assessment cannot be made without detailed electrical analysis.
- Available headroom at upstream voltage of the distribution network, which may be the limiting factor to connect new demand and generation, is modelled and the materiality headroom for different parts of the distribution network fully captured. This better aligns with the existing connections planning process run by networks.

## Modelling limitations

1. To enable accurate analysis of the distribution network, a representative Transmission model is necessary. This Transmission representation is an equivalent of the full Transmission network and, when incorporated into the WPD power system model, approximates the network behaviour. This data is provided by National Grid as part of the Week 42 data exchange. The size of the equivalent model varies for each licence area, depending on the level of GSP parallel running and interconnection. Currently Transmission models are not provided for future years, scenarios and seasons, which could increase the accuracy of future headroom modelling.
2. Only load-flows assessing steady-state voltage and power flows have been undertaken. No power quality, protection or stability studies have been carried out.
3. The Switch-Level Analyser tool does not model fault level analysis or switchgear stressing studies. This is currently modelled separately but is planned to be fully integrated into the Switch-Level Analyser tool in future.



## Future Developments

As part of the stakeholder engagement, we will be identifying areas of the network impact assessment that can be improved to ensure we provide Ofgem and the wider stakeholder group with our plans to develop our network and enable the transition to Net Zero. This covers the presentation of results in a format that is easily understandable by stakeholders, also any improvements that can be made to the analysis methodology.

The approach to investment planning ensures that WPD has a transparent framework for identifying and selecting the optimal investment plan. The distribution network continues to become more complex and active due to the decentralisation of the generation mix across the UK and more opportunities for customers to alter energy consumption and participate in flexibility markets. As a result, the analysis tools and techniques required for network impact assessment also require development. This is to ensure that the network impact assessment captures the most onerous network loading conditions, essential to the coordinated, economic and efficient design of the network.

WPD strategic vision is to continue to develop our capability to undertake forecasting and network impact assessment. For forecasting activities, this includes incorporating improved techniques to better understand the composition and coincidence of demand and generation customers to more accurately study the credible onerous network loading conditions. For network impact assessment activities, this includes further automating analysis tools and techniques to more comprehensively study our networks.

The areas for further development in the NDP are listed below:

- An updated model of the transmission network for future years, scenarios and times of year would help to increase the accuracy of power systems analysis results. Additional data exchange requirements between transmission and distribution networks is currently being explored as part of [Grid Code modification GC0139](#). WPD will continue to look to improve the network model data at the transmission and distribution boundary.
- The WPD network supplies areas that run in parallel with other distribution networks. For accurate identification of future constraints, the future growth of interconnected networks operated by other DNOs needs to be modelled. Where network constraints are identified on an interconnected network, this could be progressed through RDPs.
- Improve the technical capabilities of the existing Switch-Level Analyser tool to cover switchgear stressing studies, voltage unbalance and voltage fluctuation studies. This will align the strategic planning process with the existing connections planning process run by DNOs.
- Increase the scope of the NDP analysis to cover High Voltage (HV) networks. This requires automated tools as the complexity and size of HV networks is significantly larger than EHV networks.

Please contact [wpdnetworkstrategy@westernpower.co.uk](mailto:wpdnetworkstrategy@westernpower.co.uk) to provide any additional feedback on the content of the NDP.

## Glossary

Acronym/ Initialism	Term	Definition
<b>ANM</b>	Active Network Management	The Energy Networks Association Active Network Management Good Practice Guide [22] summarises ANM as: <i>Using flexible network customers autonomously and in real-time to increase the utilisation of network assets without breaching operational limits, thereby reducing the need for reinforcement, speeding up connections and reducing costs.</i>
<b>BSP</b>	Bulk Supply Point	A substation comprising one or more Grid Transformers and associated switchgear.
<b>CEM</b>	Common Evaluation Methodology	A methodology developed under the Open Networks project to compare options and identify low regret pathways.
<b>CEP</b>	Clean Energy Package	European legislation for a unified energy strategy for delivering the Paris agreement.
<b>CIs</b>	Customers Interrupted	The proportion of total customers whose supplies have been interrupted in a year.
<b>CMLs</b>	Customer Minutes Lost	A measure of the duration of interruptions to supply per year.
–	Demand	The consumption of electrical energy.
<b>DSR</b>	Demand Side Response	Ofgem led tariffs and schemes, which incentivise customers to change their electricity usage habits.
<b>DG</b>	Distributed Generation	Generation connected to a distribution network. Sometimes known as Embedded Generation.
<b>DNO</b>	Distribution Network Operator	A company licenced by Ofgem to distribute electricity in the United Kingdom who has a defined Distribution Services Area.
<b>DNOA</b>	Distribution Network Options Assessment	A document published twice a year by WPD providing transparency in the investment decision making process
<b>DSO</b>	Distribution System Operator	A department within WPD that creates an efficient and more flexible electricity network to meet future energy demands as well as co-ordinating transmission and distribution services at a local level with other network and system operators.
<b>ER</b>	Engineering Recommendation	A document published by the Energy Networks Association.
–	Electric Vehicle	A vehicle that uses electric motors as its method of propulsion.
<b>ESA</b>	Electricity Supply Area	Each ESA represents a block of demand and generation as visible from the Subtransmission network. Each is one of: - The geographical area supplied by a Bulk Supply Point (or group or part thereof) providing supplies at a voltage below 66kV; - The geographical area supplied by a Primary Substation supplied at 66kV (or

		group or part thereof); - A customer directly supplied at 132kV or 66kV (or by a dedicated BSP or 66kV Primary Substation) .
<b>EHV</b>	Extra High Voltage	A nominal voltage of more than 22,000 volts but not more than 72000 volts.
<b>FCO</b>	First Circuit Outage	P2/7 defines a First Circuit Outage as: <i>...a fault or an arranged Circuit outage...</i> Also referred to as N-1 in some contexts.
<b>FES</b>	Future Energy Scenarios	A set of scenarios developed by Nation Grid to represent credible future paths for the energy development of the United Kingdom.
<b>GB</b>	Great Britain	A geographical, social and economic grouping of countries that contains England, Scotland and Wales.
–	Group Load	The demand and generation of each GSP, BSP and primary substation group.
<b>GSP</b>	Grid Supply Point	A substation comprising one or more Super Grid Transformers and associated switchgear.
–	Heat Pump	Extracts heat from surroundings, which can then be used to produce hot water or space heating. There are a number of types of heat pumps; the common air source heat pumps absorb heat from the outside air.
<b>HV</b>	High Voltage	A nominal voltage of more than 1,000 volts but not more than 22,000 volts.
<b>LIFO</b>	Last In First Out	ANM logic where most recently connected ANM customers are the first have their output altered.
<b>LTDS</b>	Long Term Development Statement	An annually published document that sets out the use and likely development of the distribution network and the DNO's plans for modifying the distribution system for the following two years.
<b>NDP</b>	Network Development Plans	A plan published every two years as required by SLC 25B to provide stakeholders with transparency on network constraints and needs for flexibility.
<b>NDR</b>	Network Development Report	A component of the NDP that provides readers with valuable additional information on potential development projects.
–	National Grid	The Transmission Network Operator in England and Wales.
<b>NG ESO</b>	National Grid Electricity System Operator	National Grid Electricity System Operator is the electricity system operator for Great Britain.
<b>NGET</b>	National Grid Electricity Transmission	National Grid Electricity Transmission owns the electricity transmission network in England and Wales.

<b>NHR</b>	Network Headroom Report	Annually published dataset to indicate where it is anticipated that there will be network capacity to accommodate future connections and where flexibility services may be required.
<b>Ofgem</b>	Office for Gas and Electricity Markets	Ofgem is responsible for regulating the gas and electricity markets in the United Kingdom to ensure customers' needs are protected and promotes market competition.
–	Primary Distribution	The sections of an electrical distribution network which provide the interface between transmission and primary or Secondary Distribution. In WPD's network, the 33kV circuits and Primary Substations are considered Primary Distribution.
–	Primary Substation	A substation comprising one or more primary transformers and associated switchgear.
–	Primary Transformer	A transformer that steps voltage down from 66 or 33kV to 11kV or 6.6kV.
<b>RAS</b>	Remedial Action Scheme	Add-on module supplied by Siemens for PSS/E power system analysis software that enabled simulation of Corrective Action, control room actions in reaction to specific network conditions.
<b>RDP</b>	Regional Development Programme	A joint study between National Grid and WPD on possible 132kV reinforcement options in the South West.
<b>SCO</b>	Second Circuit Outage	P2/6 defines a Second Circuit Outage as: <i>...a fault following an arranged Circuit outage...</i> Also referred to as N-1-1 or N-2 in some contexts.
<b>SoW</b>	Statement of Works	The process under which DNOs request that National Grid assesses the potential impact of the connection of DG upon the National Electricity Transmission System.
<b>SQC</b>	Sequential Control	Method of managing the network without the need for manual intervention from a Control Engineer.
<b>UK</b>	United Kingdom	A geographical, social and economic grouping of countries that contains England, Scotland, Wales and Northern Ireland.
<b>WPD</b>	Western Power Distribution	A DNO that is licenced by Ofgem to distributed electricity in the East Midlands, West Midlands, South West, and South Wales regions of United Kingdom.
–	Subtransmission	The sections of an electrical distribution network which provide the interface between transmission and primary or Secondary Distribution. In WPD's East Midlands network the GSPs, 132kV circuits and BSPs are considered Subtransmission.

Western Power Distribution (East Midlands) plc, No2366923  
Western Power Distribution (West Midlands) plc, No3600574  
Western Power Distribution (South West) plc, No2366894  
Western Power Distribution (South Wales) plc, No2366985  
Registered in England and Wales  
Registered Office: Avonbank, Feeder Road, Bristol BS2 0TB

[wpdnetworkstrategy@westernpower.co.uk](mailto:wpdnetworkstrategy@westernpower.co.uk)

