

# Wigston

 DNOA Decision  
**Remove**

## Scheme description

There are plans to modify the 132 kV network at Wigston BSP in order to ensure the site remains P2/7 compliant. The demand on Wigston is near 100 MW, which entails a requirement to be able to restore some demand under a SCO. The reinforcement solution is to loop in Wigston to the existing 132 kV double circuit between Leicester and Kibworth and install a new 132 kV double circuit from Carlton Park to Wigston.



Constraint Season  
**None**



Flexibility Product  
**Dynamic**

## Justification for decision


Constraint no longer an issue until at least 2027 under every scenario.

## Constraint management timeline

2023 H1 **None**  
 2022 H2 Signposting  
 2022 H1 Signposting  
 2021 H2 Signposting  
 2021 H1 Signposting  
 2020 H2 Signposting  
 2020 H1 Signposting

## Estimated flex utilisation required per year (MWh):

	2023	2024	2025	2026	2027
BV					
CT					
LTW					
ST					
SP					

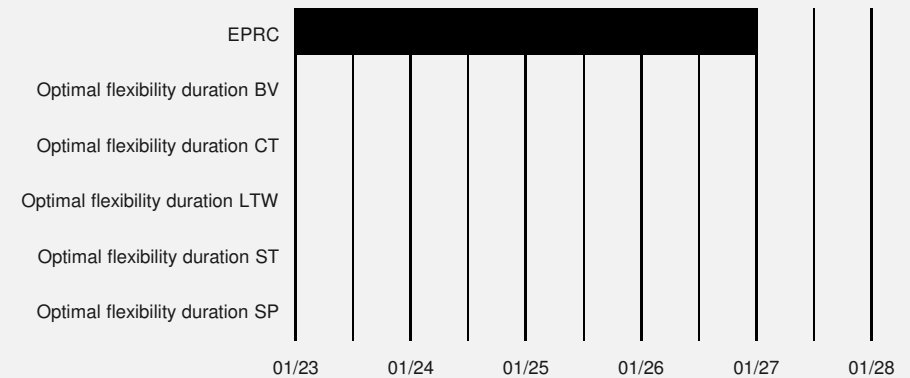

For more information visit: [nationalgrid.co.uk/network-flexibility-map-application](https://nationalgrid.co.uk/network-flexibility-map-application)