

# St Mawgan

DNOA Decision  
**Signposting**

## Scheme description

Capacity at St Mawgan primary (a single transformer site) is limited by the 11 kV backfeeds. The proposed reinforcement solution is to install a new 33/11 kV transformer at the site, along with a new 33 kV feeder circuit.



Constraint Season  
**Winter**



Flexibility Product  
**Secure**



## Justification for decision


No flexibility requirement under any scenario until 2027.

## Constraint management timeline

2023 H1 **Signposting**

## Estimated flex utilisation required per year (MWh):

	2023	2024	2025	2026	2027
<b>BV</b>					0.19
<b>CT</b>					0.10
<b>LTW</b>					0.19
<b>ST</b>					
<b>SP</b>					

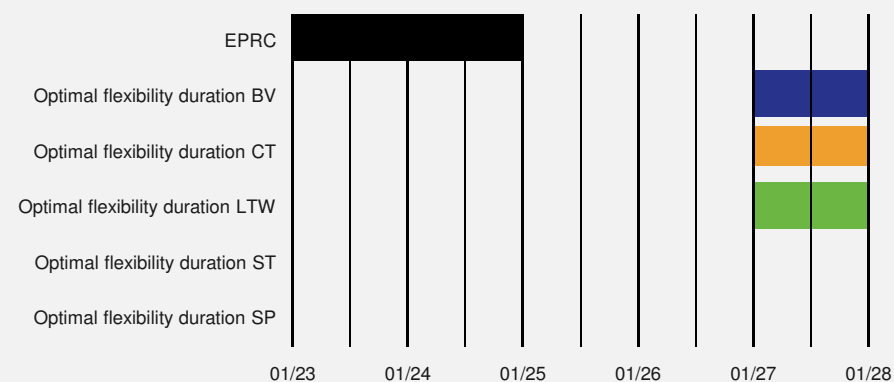

For more information visit: [nationalgrid.co.uk/network-flexibility-map-application](https://nationalgrid.co.uk/network-flexibility-map-application)