

Yeovil – Coker Tee


 DNOA Decision
Signposting

Scheme description

An N-1 outage on the 33 kV circuit from Yeovil BSP to Montacute primary leaves Coker, East Chinnock, Martock T1 and Montacute primaries fed via a single 33 kV circuit. Demand forecasts indicate this outage will overload this circuit at some point in the near future. The proposed reinforcement solution is to uprate the limiting section of circuit.



Constraint Season
Winter



Flexibility Product
Secure

Justification for decision


No flexibility requirement under any scenario until 2027.

Constraint management timeline

2023 H1 **Signposting**

Estimated flex utilisation required per year (MWh):

	2023	2024	2025	2026	2027
BV					
CT					
LTW					0.57
ST					
SP					

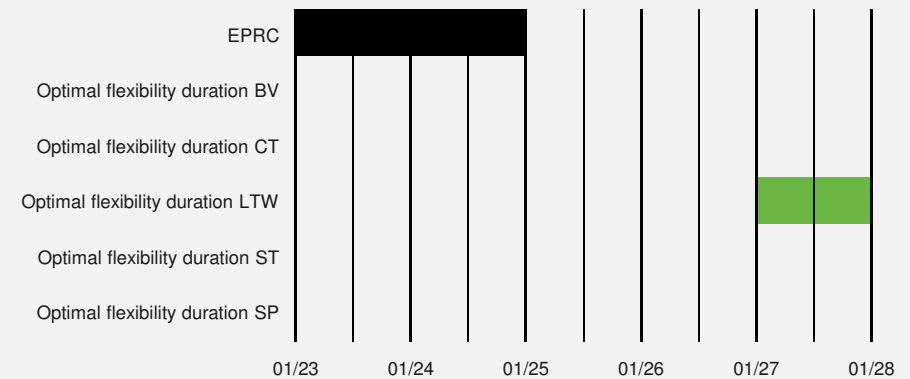

For more information visit: nationalgrid.co.uk/network-flexibility-map-application