

# Bridgwater – Bath Road


 DNOA Decision  
**Signposting**

## Scheme description

An N-1 outage on one of the 33 kV circuits from Bridgwater BSP to Bath Road primary leaves the full demand on the remaining circuit. Demand forecasts indicate this outage will overload this circuit at some point in the near future. The proposed reinforcement solution is to uprate the limiting section of circuit.



Constraint Season  
Winter



Flexibility Product  
Secure

## Justification for decision


No flexibility requirement under any scenario until at least 2025.

## Constraint management timeline

2023 H1 Signposting

## Estimated flex utilisation required per year (MWh):

	2023	2024	2025	2026	2027
BV					
CT					24.08
LTW			12.36	27.57	76.88
ST					
SP					

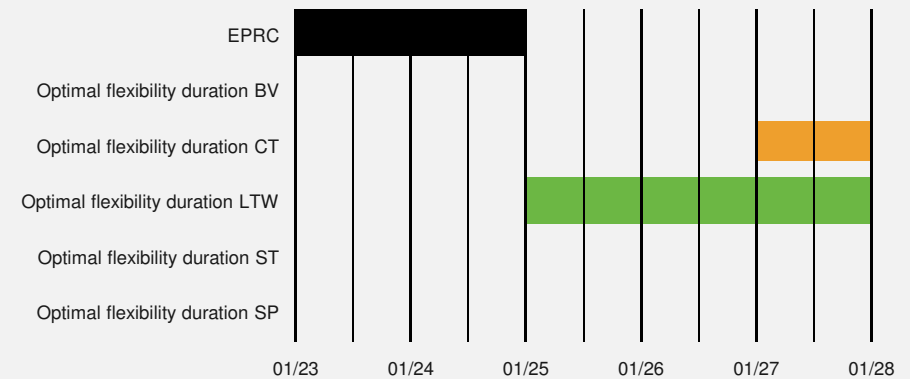

For more information visit: [nationalgrid.co.uk/network-flexibility-map-application](https://nationalgrid.co.uk/network-flexibility-map-application)