

T/D Boundary Import Curtailment Assessment Report (BESS Only)



ANM Zone	Penn GSP
Enquiry Number	9999999
Site Name	ABC Battery
Fuel Type	Battery
Capacity	49.9MW
LIFO Position	5

Import LIFO Stack ahead of site

ANM Capacity	MW	Number of Connections
Wind	0	0
Solar	0	0
Battery	70	4
Other	0	0


Curtailment Summary

Estimated Import (MWh)	250000
Uncurtailed Import (MWh)	437124
ANM Curtailment	42.81%

Constraint Considered

Penn GSP Import Technical Limits

Contour plot of curtailed energy over an average 12-month period

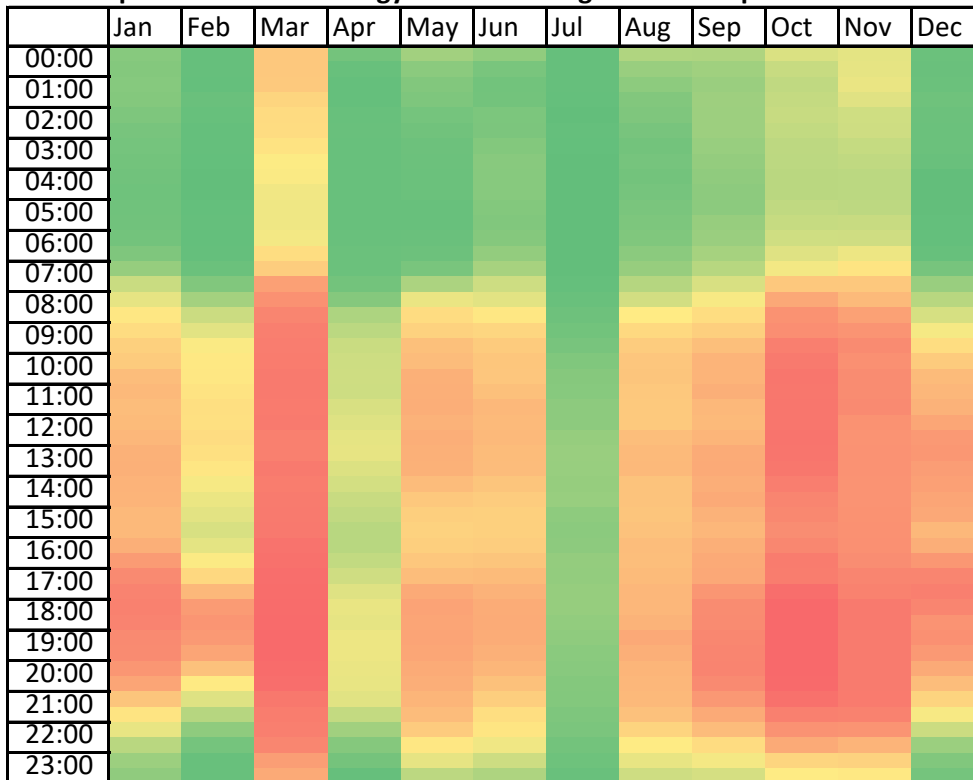

For the avoidance of doubt, NGED does not guarantee any level of duration or frequency of curtailment or constraints and this report does not replace the Curtailment Limit detailed within the Connection Offer. The Customer is strongly encouraged to conduct their own assessment of the potential curtailments / constraints and risk associated with an alternative connection. This has been calculated using the assumption that all connections in the queue ahead of the customer connection are connected.